

Date: 01-11-2025
Ref. No.: LSS/25-26/14

FORM B
[See section 3(3) and rule4(2)]

CERTIFICATE

Certified that I/We have carried out inspection of the Fire
Prevention and Life
Safety Measures installed in the following premises,
namely:-

**LATE SMT HANJABAI GAHLOT CHARITABLE TRUST
ORCHIDS THE INTERNATIONAL SCHOOL**

**ADD:- Gahlot Hall, Near D-Mart Gyan Vikas Road, 59, Kopar
khairane, Sector 14, Navi
Mumbai, Maharashtra 400709**

I/We further certify that these installations in the above
mentioned buildings are maintained in good repair and
efficient conditions during the period 1st Jan 2025 to 30th
June 2025, as required under the provisions of the
Maharashtra Fire Prevention and Life Safety Measures Act,
2006 (MAH III of 2007). The Details of the inspection
installations carried out by me/us are mentioned in the
Annexure.

License No.:-

License No. MFS / LA / RF-77 / RD-71 Date: 01.02.2024

Valid for a period from 01.02.2024 to 31.01.2026.

For Lotus Security Solutions.

Alliraja Antony
Digitally signed by Alliraja
Antony
Date: 2025.11.01 11:57:31
+05'30'

Authorised Signatory

FORM B

Annexure
Building/Premises Address

LATE SMT HANJABAI GAHLOT CHARITABLE TRUST

ORCHIDS THE INTERNATIONAL SCHOOL

ADD:- Gahlot Hall, Near D-Mart Gyan Vikas Road, 59, Kopar khairane, Sector 14, Navi

Mumbai, Maharashtra 400709

This is to certify that, the Fire Extinguisher & Fire alarm System of above building/Premises) is maintained and is in good working condition.

Following are the details of the system.

Sr.No	Items installed	Qty Nos.
•	Fire Hydrant System-	
1	Submarsibel Pump 30 H.P	01 Nos
2	Booster Pump7.5 H.P	01 Nos
3	Fire Hydrant Valve	08 Nos
4	Double door Hose box	08 Nos
5	Hose rees Drum	04 Nos
•	Fire Alaram System-	
6	Fire Alaram Panel (4 Zone)	01Nos
7	Smoke Detector	40Nos
8	MCP	05Nos
9	Hooter	05Nos
•	Fire Extinguisher	

10	ABC type Fire Extinguisher-4kg	29Nos
11	Co2 type Fire Extinguisher-4.5 kg	07Nos
12	Fire Bucket	04 nos

**The Inbuilt Fire Protection System found in good condition
on day of inspection.**

For Lotus Security Solutions.

**Alliraja
Antony**

Digitally signed
by Alliraja Antony
Date: 2025.11.01
11:26:45 +05'30'

Authorised Signatory



Govt. of Maharashtra
Directorate of Maharashtra Fire Service
Vidyanagri, Hans Bhugra Marg, Santacruz (East),
Mumbai – 400 098, Tel-022-26677555, Fax-022-26677666
www.mahafireservice.gov.in

FORM N
[(See section 9 (3) and rule 14]
License to act as a License Agency for the purpose of
Fire Prevention and Life Safety Measure

License No. MFS / LA / RF-77 / RD-71

Date: 01.02.2024

License is hereby renewed under the provisions of sub-section (3) of section 9 of the Maharashtra Fire Prevention and Life Safety Measure Act, 2006 (Mah. III of 2007) to **M/s. Lotus Security Solutions** having their registration office at **Shop 1, New Sanjay, Nityanjali Marg, Bhandup (W), Mumbai 400078** and their contact details are Office Number: 97697712008 and Email ID: mumbai@lotussecuritysolutions.com with PAN registration No. AAFFL1896F and GST No. 27AAFFL1896F to act as a License Agency for the purpose of the said Act for execution of the fire prevention and life safety measures in relation to

1. Fire Fighting and Sprinkler System: Class D
2. Detection and Fire Suppression System: Class D

M/s. Lotus Security Solutions shall not issue Form A or Form B under sub-section (3) of section 3 regarding the compliance of the fire prevention and life safety measures or maintenance thereof in good repair and efficient condition, without there being actual such compliance or maintenance failing which license granted / renewed shall be suspended or cancelled as per sub section (4) of section 9 and shall be liable for penalty under section 36 of the Act.

Subject to the provision of sub section (4) of section 9 of the said Act and rule 14 of the Maharashtra Fire Prevention and Life Safety Measures Rules, 2009, the license will be valid for a period from **01.02.2024 to 31.01.2026**

Hatyal
Kiran

Digitally signed
by Hatyal Kiran
Date: 2024.02.03
15:11:31 +05'30'

Asst Director

Alliraja
Antony

Digitally signed
by Alliraja
Antony
Date: 2024.02.02
21:55:54 -08'00'

Santosh
Shridhar
Warick

Digitally signed by
Santosh Shridhar Warick
Date: 2024.02.04 10:42:26
+05'30'

(S S Warick)
Director
Maharashtra Fire Service

Digital Signature of Authorized Person to sign Form A or Form B

Note:

* in absence of digital sign of license holder (responsible to issue Form A or Form B) the license will be treated as invalid.

Form B issue to Late Smt Hanjibai Gahlot charitable Trust orchids
The International School.

To,

The Town Planning Officer,
Navi Mumbai Municipal Corporation,
Sector-1, C.B.D. Belapur,
NAVI MUMBAI.

NO/FIRE/H.O./VASHI/.../2007
Navi Mumbai Municipal Corporation
FIRE BRIGADE VASHI, SECTOR 16-A
VASHI, NAVI MUMBAI - 400 703.
DT. 06/09/2007

Sub. :-

Fire Brigade Conditional NOC to the high rise College building on Plot No.59, Sector-15, Koparkhairne, Navi Mumbai for "Smt.Hansabai Gahlot Charitable Trust (Ground + 3 upper floors only)

Ref :-

- 1) M/s.Designo an architect building completion certificate Ref No.DES/GHALOT/2005, Dt.13/08/2007.
- 2) M/s.Sankalp Enterprises fire protection work completion letter Ref No.SE/BE/NOC/07/12, Dt.28/08/2007.
- 3) Provisional NOC Ref No.Fire/H.O./Vashi/158/2004, Dt.23/02/2004.
- 4) Revised Provisional NOC - Ref No.Fire/H.O./Vashi/684R-1/2005, Dt.22/07/2005.
- 5) Lift License No.70836/Registration No.V/OB/15587/Dt.10/07/2007.
- 6) Lift License No.70837/Registration No.V/OB/15586/Dt.10/07/2007.
- 7) Submersible Electric driven Pump No.AMP-10-011/7.5HP.
- 8) Booster Pump No.1 Sr.No.55/5HP.
- 9) Booster Pump No.2 Sr.No.176/5HP.
- 10) Inspection Fee of Rs.1490/- Paid Vide Receipt No.099668/Dt.05/09/2007 & Capitation fee Rs.12,105/- paid vide Receipt No.099667/Dt.05/09/2007 (Total Area Education-4835.88 + Com.-556.432 Sq.Mtrs)

Dear Sir,

We visited to the above site on 04/09/2007 & inspected the existing fire protection system. On inspection it is observe that "M/s. Sankalp Enterprises fire protection system" has physically provided the complete Wet-Riser-Cum-Down-Comer System to the high rise College building on Plot No. 59, Sector-15, Koparkhairne, Navi Mumbai for "Smt.Hansabai Gahlot Charitable Trust (Ground + 3 upper floors only). As there is no Electrical Supply due to lack of Occupancy Certificate. The School Management/Fire Contractor is not in position to give the practical operation of Electric & Booster Pumps. Therefore, As far as this section is concerned there is no objection to issue the Occupancy Certificate.

However, it is the responsibility of the College Management to give the testing of above fixed fire protection systems within 6 months or after getting permanent electrical supply. Then Final NOC will be issued.

Yours Faithfully,


(R.T.MHATRE)

FIRE OFFICER

Navi Mumbai Municipal Corporation
Mumbai, India

To,

The Town Planning Officer,
Navi Mumbai Mahanagar Palika
Sector-1, CBD, Belapur,
NAVI MUMBAI -400 614.

NO/FIRE/H.O/VASHI/694R-1/2005
Navi Mumbai Municipal Corporation
FIRE BRIGADE VASHI, SECTOR 14-A
VASHI, NAVI MUMBAI-400705
22/07/2005

Sub:- Fire Brigade Revised Provisional NOC to the proposed College and Part Commercial building on Plot No.59, Sector-14 at Koparkhata, Navi Mumbai for "M/s. Hansabai Gahlot Charitable Trust."

Ref:- (1) M/s. Designo an Architect Revised Proposal Dt.19/07/2005.
(2) Change of user and enhancement of FSI letter Ref.No.CIDCO/EMS/AEO (HO)/2003/2794/Dt. 11/11/2003.
(3) Proposal NOC Ref. No. Fire/HO/Vashi/158/2004, Dt. 23/02/2004.
(4) Additional Capitation fees Rs.12,000/- paid in cash vide Receipt No.059162/Dt.22/07/2005 Pay Order No.034096/Dt.21/07/2005 The National Co.Op. Bank Ltd, Mumbai

Dear Sir,

This section had been already cleared NOC for Stilt on the ground + 3 upper floors to the height of 14.40 mts. along with 33 Nos. car parking in the stilt & 4 Nos. car parking Laybye (Total 37 car parkings) were proposed in the previous NOC.

Now architect had submitted the revised proposal for construction of Shops on ground floor for Stationary, bookshops, Banks, Xerox centers, Sports equipments and other compatible use at the North side of the building and on 3rd floor class rooms and hall to the height of 15.750 Mtrs. and also proposed 15 Nos. in the stilt, 42 Nos. in the open space and 6 Nos. lay bye.

The 4.5 Mtrs wide open space around this structure will be strictly maintained for movement of Fire Brigade vehicles apart from car parking. Therefore, this section has no objection for construction of above structure subject to following conditions.

- 1) Under Ground Tank:- Proposed 35,000 liters under ground water tank for fire fighting has been accepted.
- 2) Electrical pump:- Proposed electrical pump capacity 900 liters/minutes giving the pressure not less than 3.2 kg/cm² at the top most hydrant.
- 3) Inlet Breaching:- Two way male adopter inlet breaching to be provided on the fighting.
- 4) Courtyard Hydrant:- Proposed 3 Nos. courtyard hydrants has been accepted.
- 5) Siamese Connection:- Proposed 1 No. Siamese connection has been accepted.
- 6) Wet Riser:- Proposed wet riser (IS 3438/1966) should be a size of 100 mm G.I. 'C' class riser running from the pump to courtyard shall be taken fire duct right up to the terrace level booster & 100 mm G.I. 'C' class

7) Fire Duct:

(with glass doors)

Each floor level including ground floor fire duct should be provided. It should be continuous and should be sealed properly at each floor level and should contain as follows,

MINIMUM SIZE AREA

(1) 100mm G.I. 'C' class riser on the both staircase.

Height: 1.4 Mtrs.

Width : 1.00 Mtr.

Depth : 1.00 Mtr.

(Write word FIRE on it)

(2) 63mm gunmetal female single hydrant (IS 5290/1966).

(3) 30 mts length thermoplastic synthetic hose reel (IS:12585-1988) shall be used.

(4) 15mts flax RRL hose (IS 636) fitted with male & female couplings of 63 mm dia with one Nozzle IS 903/1933 shall be provided.

8) Over Head Tank:

Proposed 10,000 liters over head water tank should purely kept for fire fighting on the terrace has been accepted. Your incoming water should fall into fire fighting tank & over flow domestic tank to into avoid mildew and it should be according to part IV National Building code-1983.

9) Booster:-

Proposed booster at the terrace level should be capable to boost 450 liters/minutes giving the pressure not less than 2.1 kgs at the top most hydrant has been accepted. Kindly note that switch to be provided at pump room & other at ground floor level with marking, so we can operate the pump from two places.

10) Portable Fire Appliances:-

Ground Floor

Dry Chemical Powder fire extinguisher IS:2171 - 5 Kgs
Capacity = 02 Nos. in each shop to be provided.

3rd floor :-

- 1) Dry Chemical Powder fire extinguisher IS:2171 - 5 Kgs-
Capacity - 06 Nos. to be provided.
- 2) Water type Co2 Gas fire extinguisher IS:940 - 9 liters
Capacity - 2 Nos. to be provided.
- 3) Co2 Gas fire extinguisher IS:2878 - 4.5 kgs capacity
- 2Nos. to be provided.

11) Fire Brigade Conditions:- Remaining fire brigade conditions will remains same as per the earlier NOC vide Ref No.2 given above.



Yours Faithfully,

[Signature]



नवी मुंबई^१
महानगरपालिका

परिवार माला, बेलपूर भवन, सी.सी.सी.
नवी मुंबई - ४०० ६१४.
ट्रायांपी क्र. : २६५४ ६० ६०
२६५४ ५७ ००
फैक्स: २६५४ ३७ ८५

Navi Mumbai
Municipal Corporation

1ST FLOOR, BELAPUR BHAVAN, C.B.D.,
NAVI MUMBAI - 400 614.
TEL. No. : 2757 70 70
2757 57 00
FAX: 2757 37 85

प्रती,

मे. गेहवोत इन्स्टिट्युट ऑफ फार्मासी,
स्लॉट नं. ५१, सेक्टर-१४, कोपर्हैरने,
नवी मुंबई.

जान्म. / अग्नि / सुरक्षा क्र. / नाती / ..६२२ / ०८
पर्यायी मुंबई महानगरपालिका अग्निशमन कार्यालय
पार्शी, नवी मुंबई ४०० ६१४ उपर्युक्त
सिनाक: २५०/०२ / ०८

विषय: - न.म.म.पा. अग्निशमन दलाचा ऑब्सॉल्यूट अल्कोहोल (१०० लिटर) चा साठा करण्यास
ना-हरकत दाखला.

संदर्भ: - (१) आपला अर्ज संदर्भ क्र.जीआयपी/१०/२००८, दि.१२/०२/२००८
 (२) मे.एस.एम.इंटरप्रायजेस यांच्याकडून आग विद्याविषयाची उपकरणे खोरेदी केलेल्याचे
इनकाईस क्र.११२/दि.२५/०२/२००८.
 (३) नमूनपा भोगवटा प्रमाणपत्र क्र.जा.क्र./नरवि/भोप्र/प्र.क्र.वी ४८५५६/२८५५/२००८,
दि.२२/०१/२००८.
 (४) अग्निशमन दलाचा ना-हरकत दाखला शुल्क रु. ५००/- पावरी क्र.१००५३१,
दि.२२/०२/२००८.

महाराष्य,

उपरोक्त संदर्भप्रिमाणे दि.२२/०२/२००८ रोजी आपल्या वाणीज्य इमारत भुखंड क्र.५९, सेक्टर-१४, कोपर्हैरने,
नवी मुंबई येथील ऑब्सॉल्यूट अल्कोहोलचा साठा असणा-या रुमची पाहणी केली असता सुरक्षिततेच्या दृष्टीने खालील
आग विद्याविषयाची उपकरणे सदर ठिकाणी सुस्थितीत ठेवली असल्याची निर्दर्शनास आले आहे.

१) डी.सी.पी. फायर एक्सटिंग्युशर - ०५ किलो दूमतां - २ नग.

त्यामुळे खालील अर्टी व शर्टीच्या अधिन राहुन आपल्याला वरील नमुद केलेल्या ठिकाणी सॉल्वंट (१०० लिटर)
चा साठा करण्यास नवी मुंबई महानगर पालिका अग्निशमन दलाचा ना-हरकत दाखला देण्यात येत आहे.

१) आग विद्याविषयाच्या साधनांची वेळच्या वेळी रिफीरिंग व ट्रेस्टींग करण्याची जबाबदारी संवधितांवर ठाहील.
 २) सदर रुममधील कर्मचा-यांना आग विद्याविषयाची उपकरणे हाताळण्याचे प्रशिक्षण देणे.
 ३) आपल्यालीन घटनेच्या वेळी अग्निशमन दलाची वाहने ज्ञाण्यास अडथळ्या येणार नाही यासाठी अनप्रिकृत घायकास
किंवा याहने कंपनीसमोर पाकीग करू नये.

-मार्गे पहा-


M. Malve

M. Malve

M. Malve

PRINCIPAL
GAHLOT INSTITUTE OF PHARMACY
Gahlot Technical Education Complex
Koparkhairne, Navi Mumbai.


PRINCIPAL
GAHLOT INSTITUTE OF PHARMACY
Gahlot Technical Education Complex
Koparkhairne, Navi Mumbai.



१२०

- ४) सदर रुममधील इलेक्ट्रीक वायरींग व उपकरणांना आर्थींग करणे.
- ५) सदर रुममध्ये वायरींग किंवा उपकरणाजवळ साठा करू नये.
- ६) प्रवेशावार, चाहेर जाण्याचा रस्ता, पैसेजमध्ये कुठल्याही प्रकारचा अडयला येणार नाही याची दक्षता घ्यावी.
- ७) सदर रुममध्ये खेळव्ही हवा राहील तसेच साफ-सफाई व्यवस्थीत ठेवावी.
- ८) सदर रुममध्ये इतर प्रकारचा ज्यालाग्याही पदार्थाचा साठा ठेऊ नये.
- ९) साठा केलेल्या रुममध्ये खेळव्ही हवा राहील याची दक्षता घ्यावी.
- १०) सदर रुममध्ये धुम्रपान नियेधचा फ्लक मराठी व इंग्रजीमध्ये लावावा.
- ११) सदर रुममध्ये इलेक्ट्रिक हिटर व विजेवर चालणारी उपकरणे घापरु नये.
- १२) सदर रुममध्ये कामगारांना जाण्या-येण्यासाठी भोकळी जागा ठेवावी.
- १३) सदर रुममधील कॉटन वेस्ट इत्यांदी टांकाऊ यस्तु पत्राच्या डव्यात गोळा करून दररोज त्याची विलेवाट लावावी.
- १४) सदर व्यवसाय करण्यासाठी नवी मुंबई महानगरपालिकेची परवानगी घेणे आवश्यक आहे.
- १५) एखादी घटना घडल्यास अग्निशमन केंद्र, घारंगी, सॉ.वी.डी. व.रैसेलीसाठी आनुक्रमे दुरव्यनी क्र.१०२, २७६६०३०३, ३०३, २७५७२१११ व २७६०६६०० वर संपर्क साधावा तसेच सदरचे दुरव्यनी क्रमांक पॅनल चोर्डवर लिहिणे.
- १६) आग विझविण्याच्या साधनांची वेळच्या वेळी रिफीर्लिंग व टेर्स्टींग केल्यानंतरच्य सदरच्या ना-हरकत दाखल्याचे नुतनीकरण करण्यात येईल.
- १७) ३० व्यक्तींना पुरेल इतका प्रथमोचार वॉक्स ठेवावा.
- १८) आग विझविण्यांची उपकरणे बंद स्थितीत असल्यास सदरची जवाबदारी संविधितांवर राहील.
- १९) नवी मुंबई महानगर पालिकेचा कर वेळच्या वेळी भरणे आवश्यक आहे अन्यथा सदर ना-हरकत दाखला रद्द होईल.
- २०) सदर व्यवसायाच्यात नागरिकांच्या तक्रारी प्राप्त झाल्यास सदरचा ना-हरकत दाखला रद्द करण्यात येईल.
- २१) सदर ना-हरकत दाखल्याची मुदत डिसेंबर-२००८ पर्यंतच्या कालावधीसाठी राहील.

सदर अर्टीचे काटेकोरपणे पालन करण्याची जवाबदारी संविधितांवर राहिल.

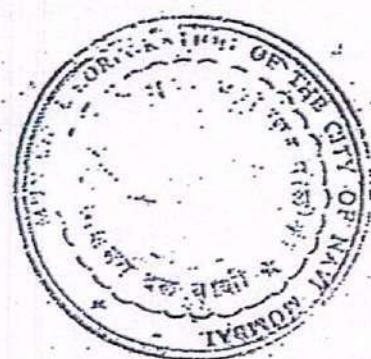

१२०११
नवी मुंबई महानगरपालिका

Date : 09/12/2019



L.S.H.G.C.T.

To,
DFO


Navi Mumbai Municipal Corporation,
Navi Mumbai,

Subject: - Application for Issuing FIRE NOC COPY and Drawing.

Dear Sir,

Here we would request you to kindly Issue Copy Of fire NOC Along with Drawing of
below said Premises

GAHLOT INSTITUTE OF PHARMACY
PLOT No.59, Sector 14,
Kopar Khairane
Navi Mumbai 400703

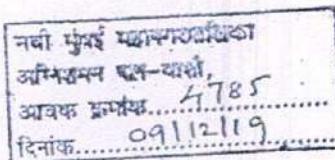

Srikrishna

Orchids The International School

Principal

Prayna Torane



LATE SMT. HANJABAI GAHLOT CHARITABLE TRUST

Gahlot Complex, Plot No 28 A, Sector 10, Opp Sarsola Bus Depot (Phase - II) Nerul, Navi Mumbai - 400 706

Date: 01-11-2025
Ref. No.: LSS/25-26/14

FORM B
[See section 3(3) and rule4(2)]

CERTIFICATE

Certified that I/We have carried out inspection of the Fire
Prevention and Life
Safety Measures installed in the following premises,
namely:-

**LATE SMT HANJABAI GAHLOT CHARITABLE TRUST
ORCHIDS THE INTERNATIONAL SCHOOL**

**ADD:- Gahlot Hall, Near D-Mart Gyan Vikas Road, 59, Kopar
khairane, Sector 14, Navi**

Mumbai, Maharashtra 400709

I/We further certify that these installations in the above
mentioned buildings are maintained in good repair and
efficient conditions during the period 1st Jan 2025 to 30th
June 2025, as required under the provisions of the
Maharashtra Fire Prevention and Life Safety Measures Act,
2006 (MAH III of 2007). The Details of the inspection
installations carried out by me/us are mentioned in the
Annexure.

License No.:-

License No. MFS / LA / RF-77 / RD-71 Date: 01.02.2024

Valid for a period from 01.02.2024 to 31.01.2026.

For Lotus Security Solutions.

Alliraja Antony

Digitally signed by Alliraja
Antony
Date: 2025.11.01 11:57:31
+05'30'

Authorised Signatory

FORM B

Annexure
Building/Premises Address

LATE SMT HANJABAI GAHLOT CHARITABLE TRUST

ORCHIDS THE INTERNATIONAL SCHOOL

ADD:- Gahlot Hall, Near D-Mart Gyan Vikas Road, 59, Kopar khairane, Sector 14, Navi

Mumbai, Maharashtra 400709

This is to certify that, the Fire Extinguisher & Fire alarm System of above building/Premises) is maintained and is in good working condition.

Following are the details of the system.

Sr.No	Items installed	Qty Nos.
•	Fire Hydrant System-	
1	Submarsibel Pump 30 H.P	01 Nos
2	Booster Pump7.5 H.P	01 Nos
3	Fire Hydrant Valve	08 Nos
4	Double door Hose box	08 Nos
5	Hose rees Drum	04 Nos
•	Fire Alaram System-	
6	Fire Alaram Panel (4 Zone)	01Nos
7	Smoke Detector	40Nos
8	MCP	05Nos
9	Hooter	05Nos
•	Fire Extinguisher	

10	ABC type Fire Extinguisher-4kg	29Nos
11	Co2 type Fire Extinguisher-4.5 kg	07Nos
12	Fire Bucket	04 nos

**The Inbuilt Fire Protection System found in good condition
on day of inspection.**

For Lotus Security Solutions.

**Alliraja
Antony**

Digitally signed
by Alliraja Antony
Date: 2025.11.01
11:26:45 +05'30'

Authorised Signatory



Govt. of Maharashtra
Directorate of Maharashtra Fire Service
Vidyanagri, Hans Bhugra Marg, Santacruz (East),
Mumbai – 400 098, Tel-022-26677555, Fax-022-26677666
www.mahafireservice.gov.in

FORM N
[(See section 9 (3) and rule 14]
License to act as a License Agency for the purpose of
Fire Prevention and Life Safety Measure

License No. MFS / LA / RF-77 / RD-71

Date: 01.02.2024

License is hereby renewed under the provisions of sub-section (3) of section 9 of the Maharashtra Fire Prevention and Life Safety Measure Act, 2006 (Mah. III of 2007) to **M/s. Lotus Security Solutions** having their registration office at **Shop 1, New Sanjay, Nityanjali Marg, Bhandup (W), Mumbai 400078** and their contact details are Office Number: 97697712008 and Email ID: mumbai@lotussecuritysolutions.com with PAN registration No. AAFFL1896F and GST No. 27AAFFL1896F to act as a License Agency for the purpose of the said Act for execution of the fire prevention and life safety measures in relation to

1. Fire Fighting and Sprinkler System: Class D
2. Detection and Fire Suppression System: Class D

M/s. Lotus Security Solutions shall not issue Form A or Form B under sub-section (3) of section 3 regarding the compliance of the fire prevention and life safety measures or maintenance thereof in good repair and efficient condition, without there being actual such compliance or maintenance failing which license granted / renewed shall be suspended or cancelled as per sub section (4) of section 9 and shall be liable for penalty under section 36 of the Act.

Subject to the provision of sub section (4) of section 9 of the said Act and rule 14 of the Maharashtra Fire Prevention and Life Safety Measures Rules, 2009, the license will be valid for a period from **01.02.2024 to 31.01.2026**

Hatyal
Kiran

Digitally signed
by Hatyal Kiran
Date: 2024.02.03
15:11:31 +05'30'

Asst Director

Alliraja
Antony

Digitally signed
by Alliraja
Antony
Date: 2024.02.02
21:55:54 -08'00'

Santosh
Shridhar
Warick

Digitally signed by
Santosh Shridhar Warick
Date: 2024.02.04 10:42:26
+05'30'

(S S Warick)
Director
Maharashtra Fire Service

Digital Signature of Authorized Person to sign Form A or Form B

Note:

* in absence of digital sign of license holder (responsible to issue Form A or Form B) the license will be treated as invalid.

Form B issue to Late Smt Hanjibai Gahlot charitable Trust orchids
The International School.