

To,
The Town Planning Officer,
Navi Mumbai Municipal Corporation,
Sector-1, C.B.D. Belapur,
NAVI MUMBAI.

NO/FIRE/H.O./VASHI/796/2007
Navi Mumbai Municipal Corporation
FIRE BRIGADE VASHI, SECTOR 16-A
VASHI, NAVI MUMBAI - 400 703
DT. 06 / 09 / 2007

Sub. :- Fire Brigade Conditional NOC to the high rise College building on Plot No.59, Sector-15, Koparkhairne, Navi Mumbai for "Smt.Hansabai Gahlot Charitable Trust (Ground + 3 upper floors only)


- Ref :-
- 1) M/s.Designo an architect building completion certificate Ref No.DES/ GHALOT/2005, Dt.13/08/2007.
 - 2) M/s.Sankalp Enterprises fire protection work completion letter Ref No.SE/BE/NOC/07/12, Dt.28/08/2007.
 - 3) Provisional NOC Ref No.Fire/H.O./Vashi/158/2004, Dt.23/02/2004.
 - 4) Revised Provisional NOC - Ref No.Fire/H.O./Vashi/684R-1/2005, Dt.22/07/2005.
 - 5) Lift License No.70836/Registration No.V/OB/15587/Dt.10/07/2007.
 - 6) Lift License No.70837/Registration No.V/OB/15586/Dt.10/07/2007.
 - 7) Submersible Electric driven Pump No.AMP-10-011/7.5HP.
 - 8) Booster Pump No.1 Sr.No.55/5HP.
 - 9) Booster Pump No.2 Sr.No.176/5HP.
 - 10) Inspection Fee of Rs.1490/- Paid Vide Receipt No.099668/Dt.05/09/2007 & Capitation fee Rs.12,105/- paid vide Receipt No.099667/Dt.05/09/2007 (Total Area Education-4835.88 + Com.-556.432 Sq.Mtrs)

Dear Sir,

We visited to the above site on 04/09/2007 & inspected the existing fire protection system. On inspection it is observe that "M/s. Sankalp Enterprises fire protection system" has physically provided the complete Wet-Riser-Cum-Down-Comer System to the high rise College building on Plot No. 59, Sector-15, Koparkhairne, Navi Mumbai for "Smt.Hansabai Gahlot Charitable Trust (Ground + 3 upper floors only). As there is no Electrical Supply due to lack of Occupancy Certificate. The School Management/Fire Contractor is not in position to give the practical operation of Electric & Booster Pumps. Therefore, As far as this section is concerned there is no objection to issue the Occupancy Certificate.

However, it is the responsibility of the College Management to give the testing of above fixed fire protection systems within 6 months or after getting permanent electrical supply. Then Final NOC will be issued.

Yours Faithfully,


(R.T.MHATRE)

FIRE OFFICER

Navi Mumbai Municipal Corporation

Copy: 1) M/s. Designo Architect)

NO/FIRE/H.O/VASHI/684R-1/2005
Navi Mumbai Municipal Corporation
FIRE BRIGADE VASHI, SECTOR 14-A
VASHI, NAVI MUMBAI-400745
22/07/2005

To,
The Town Planning Officer,
Navi Mumbai Mahanagar Palika
Sector-1, CBD, Belapur,
NAVI MUMBAI-400614.

Sub: - Fire Bridge Revised Provisional NOC to the proposed College and Part Commercial building on Plot No.59, Sector-14 at Koparkhane, Navi Mumbai For "M/s.Hansahai Gahlot Charitable Trust."

Ref: - (1) M/s. Designo an Architect Revised Proposal Dt.19/07/2005.
(2) Change of user and enhancement of FSI letter Ref.No.CIDCO/EMS/AEO (HQY/2003/2794/Dt. 11/11/2003).
(3) Proposal NOC Ref. No. Fire/HO/Vashi/158/2004, Dt. 23/02/2004.
(4) Additional Capitation fees Rs.12,000/- paid in cash vide Receipt No.059162/Dt.22/07/2005 Pay Order No.034096/Dt.21/07/2005 The National Co.Op. Bank Ltd. Mumbai

Dear Sir,

This section had been already cleared NOC for Stilt on the ground + 3 upper floors to the height of 14.40 mts. along with 33 Nos. car parking in the stilt & 4 Nos. car parking Laybye (Total 37 car parkings) were proposed in the previous NOC.

Now architect had submitted the revised proposal for construction of Shops on ground floor for Stationary, bookshops, Banks, Xerox centers, Sports equipments and other compatible use at the North side of the building and on 3rd floor class rooms and hall to the height of 15.750 Mtrs. and also proposed 15 Nos. in the stilt, 42 Nos. in the open space and 6 Nos. lay bye.

The 4.5 Mtrs wide open space around this structure will be strictly maintained for movement of Fire Brigade vehicles apart from car parking. Therefore, this section has no objection for construction of above structure subject to following conditions.

- 1) Under Ground Tank:- Proposed 35,000 liters under ground water tank for fire fighting has been accepted.
- 2) Electrical pump:- Proposed electrical pump capacity 900 liters/minutes giving the pressure not less than 3.2 kgs/cm² at the top most hydrant.
- 3) Inlet Breaching:- Two way male adopter inlet breaching to be provided on the fighting.
- 4) Courtyard Hydrant:- Proposed 3 Nos. courtyard hydrants has been accepted.
- 5) Siamese Connection:- Proposed 1 No. Siamese connection has been accepted.
- 6) Wet Riser :- Proposed wet riser (IS 3432/1966) should be a size of 100 mm G.I. 'C' class riser running from the pump to courtyard shall be taken fire duct right up to the terrace level booster & 100 mm G.I 'C' class

7) Fire Duct:-
(with glass doors)

Each floor level including ground floor fire duct should be provided. It should be continuous and should be sealed properly at each floor level and should contain as follows,

MINIMUM SIZE AREA

Height: 1.4 Mtrs.

Width : 1.00 Mtr.

Depth : 1.00 Mtr.

(Write word FIRE on it)

- (1) 100mm G.L. 'C' class riser on the both staircase.
- (2) 63mm gunmetal female single hydrant (IS 5290/1966).
- (3) 30 mts length thermoplastic synthetic hose reel (IS:12585-1988) shall be used.
- (4) 15mts flax RRL hose (IS 636) fitted with male & female couplings of 63 mm dia with one Nozzle IS 903/1933 shall be provided.

8) Over Head Tank:-

Proposed 10,000 liters over head water tank should purely kept for fire fighting on the terrace has been accepted. Your incoming water should fall into fire fighting tank & over flow domestic tank to into avoid mildew and it should be according to part IV National Building code-1983.

9) Booster:-

Proposed booster at the terrace level should be capable to boost 450 liters/minutes giving the pressure not less than 2.1 kgs at the top most hydrant has been accepted. Kindly note that switch to be provided at pump room & other at ground floor level with marking, so we can operate the pump from two places..

10) Portable Fire Appliances:-


Ground Floor

Dry Chemical Powder fire extinguisher IS:2171 - 5 Kgs Capacity = 02 Nos. in each shop to be provided.

3rd floor :-

- 1) Dry Chemical Powder fire extinguisher IS:2171 - 5 Kgs Capacity - 06 Nos. to be provided.
- 2) Water type Co2 Gas fire extinguisher IS:940 - 9 liters Capacity - 2 Nos. to be provided.
- 3) Co2 Gas fire extinguisher IS:2878 - 4.5 kgs capacity - 2Nos. to be provided.

11) Fire Brigade Conditions:- Remaining fire brigade conditions will remains same as per the earlier NOC vide Ref No.2 given above.

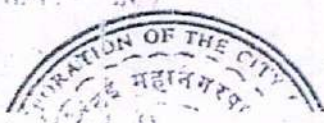

Yours Faithfully,

[Signature]



नवी मुंबई महानगरपालिका

पहिल माध्य, बेलपूर भवन, सी.बी.डी.,
नवी मुंबई - ४०० ६१४.
दूरध्वनी क्र. : २७५७ ७०७०
२७५७ ५७००
फॅक्स : २७५७ ३७८५

Navi Mumbai Municipal Corporation

1ST FLOOR, BELAPUR BHAVAN, C.B.D.,
NAVI MUMBAI - 400 614.
TEL. No. : 2757 70 70
2757 57 00
FAX : 2757 37 85

प्रती,

मे. गेहलोत इन्स्टिटयुट ऑफ फार्मासी,
प्लॉट नं. ५९, सेक्टर-१४, कोपरखैरणे,
नवी मुंबई.

प्रा.क्र./अग्नि/मुद्रांकन/माली/७२२/०८
नवी मुंबई महानगरपालिका अग्निशमन कार्यालय
प्रा.क्र. नवी मुंबई ४८८ ३८३
दिनांक:- २७/०२/०८

विषय :- न.मु.म.पा. अग्निशमन दलाचा अॅबसॉल्युट अल्कोहोल (१०० लिटर) चा साठा करण्यास
ना-हरकत दाखला.

- संदर्भ :- (१) आपला अर्ज संदर्भ क्र.जीआयपी/९०/२००८, दि.१२/०२/२००८.
(२) मे.एस.एम.इंटरप्रायजेस यांच्याकडून आग विझविण्याची उपकरणे खरेदी केल्याचे
इनव्हाईस क्र.१९२/दि.२५/०२/२००८.
(३) नमुंमपा भोगवटा प्रमाणपत्र क्र.जा.क्र./नरवि/भोगप्र/प्र.क्र.बी ४८५७/२८५/२००८,
दि.२२/०१/२००८.
(४) अग्निशमन दलाचा ना-हरकत दाखला शुल्क रु. ५००/- पावती क्र.१००५३१,
दि.२२/०२/२००८.

महाराज,

उपरोक्त संदर्भाप्रमाणे दि.२२/०२/२००८ रोजी आपल्या वाणीज्य इमारत भुखंड क्र.५९, सेक्टर-१४, कोपरखैरणे,
नवी मुंबई येथील अॅबसॉल्युट अल्कोहोलचा साठा असणा-या रुमची पाहणी केली असता सुरक्षिततेच्या दृष्टीने खालील
आग विझविण्याची उपकरणे सदर ठिकाणी सुस्थितीत ठेवली असल्याची निदर्शनास आले आहे.

- १) डी.सी.पी. फायर एक्सटिंग्शुअर - ०५ किलो क्षमता - २ नग.

त्यामुळे खालील अटी व शर्तीच्या अधिन राहून आपल्याला घरील नमुद केलेल्या ठिकाणी सॉल्वेंट (१०० लिटर)
चा साठा करण्यास नवी मुंबई महानगरपालिका अग्निशमन दलाचा ना-हरकत दाखला देण्यात येत आहे.

- १) आग विझविण्याच्या साधनांची वेळच्या वेळी रिफीलिंग व टेस्टिंग करण्याची जबाबदारी संबंधितांवर राहिल.
२) सदर रुममधील कर्मचा-यांना आग विझविण्याची उपकरणे हाताळण्याचे प्रशिक्षण देणे.
३) आपत्कालीन घटनेच्या वेळी अग्निशमन दलाची वाहने जाण्यास अडथळा येणार नाही यासाठी अनधिकृत बांधकाम
किंवा वाहने कंपनीसमोर पार्किंग करू नये.

-मागे पहा:-



[Signature]

[Signature]

[Signature]


PRINCIPAL
GAHLOT INSTITUTE OF PHARMACY
3rd Floor Technical Education Complex
Koparkhairne, Navi Mumbai.



PRINCIPAL
GAHLOT INSTITUTE OF PHARMACY
Gahlot Technical Education Complex
Koparkhairne, Navi Mumbai.

- ४) सदर रुममधील इलेक्ट्रीक वायरिंग व उपकरणांना आर्यीग करणे.
- ५) सदर रुममध्ये वायरिंग किंवा उपकरणाजवळ साठा करू नये.
- ६) प्रवेशद्वार, बाहेर जाण्याचा रस्ता, पैसेजमध्ये कुठल्याही प्रकारचा अडथळा येणार नाही याची दक्षता घ्यावी.
- ७) सदर रुममध्ये खेळती हवा राहिल तसेच साफ-सफाई व्यवस्थित ठेवावी.
- ८) सदर रुममध्ये इतर प्रकारचा ज्वालाग्राही पदार्थाचा साठा ठेऊ नये.
- ९) साठा केलेल्या रुममध्ये खेळती हवा राहिल याची दक्षता घ्यावी.
- १०) सदर रुममध्ये धुम्रपान निषेधचा फलक मराठी व इंग्रजीमध्ये लावावा.
- ११) सदर रुममध्ये इलेक्ट्रिक हिटर व विजेवर चालणारी उपकरणे थापणू नये.
- १२) सदर रुममध्ये कामगारांना जाण्या-येण्यासाठी मोकळी जागा ठेवावी.
- १३) सदर रुममधील कॅबिन, बेस्ट इत्यादी टांकाऊ वस्तु पत्र्याच्या डब्यात गोळा करून दररोज त्याची विल्हेवाट लावावी.
- १४) सदर व्यवसाय करण्यासाठी नवी मुंबई महानगरपालिकेची परवानगी घेणे आवश्यक आहे.
- १५) एखादी घटना घडल्यास अग्निशमन केंद्र, चारंगी, सी.बी.डी. व रैरोलीसाठी अनुक्रमे दुरध्वनी क्र. १०२, २७६६०१०३, १०१, २७५७२१११ व २७६०६६०० वर संपर्क साधावा तसेच सदरचे दुरध्वनी क्रमांक पॅनल बोर्डवर लिहिणे.
- १६) आग विझविण्याच्या साधनांची वेळच्या वेळी रिफीलिंग व टेस्टिंग केल्यानंतरच सदरच्या ना-हरकत दाखल्याचे नुतनीकरण करण्यात येईल.
- १७) १० व्यक्तींना पुरेल इतका प्रथमोचार बॉक्स ठेवावा.
- १८) आग विझविण्याची उपकरणे बंद स्थितीत असल्यास सदरची जबाबदारी संबंधितांवर राहिल.
- १९) नवी मुंबई महानगर पालिकेचा फर वेळच्या वेळी भरणे आवश्यक आहे अन्यथा सदर ना-हरकत दाखला रद्द होईल.
- २०) सदर व्यवसायाबाबत नागरिकांच्या तक्रारी प्राप्त झाल्यास सदरचा ना-हरकत दाखला रद्द करण्यात येईल.
- २१) सदर ना-हरकत दाखल्याची मुदत डिसेंबर-२००८ पर्यंतच्या कालावधीसाठी राहिल.

सदर अटीचे काटेकोरपणे पालन करण्याची जबाबदारी संबंधितांदर राहिल.

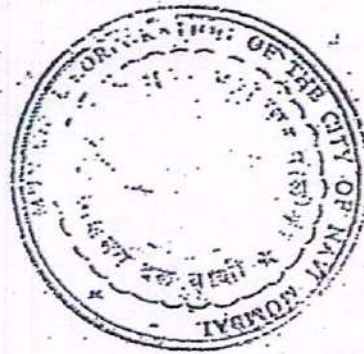

२१/१२/२००८
अग्निशमन अधिकारी
नवी मुंबई महानगरपालिका

Date: 09/12/2019



L.S.H.G.C.T.


To,
DFO
Navi Mumbai Municipal Corporation,
Navi Mumbai,

Subject: - Application for Issuing FIRE NOC COPY and Drawing.

Dear Sir,

Here we would request you to kindly Issue Copy Of fire NOC Along with Drawing of below said Premises

GAHLOT INSTITUTE OF PHARMACY
PLOT No.59, Sector 14,
Kopar Khairane
Navi Mumbai 400703

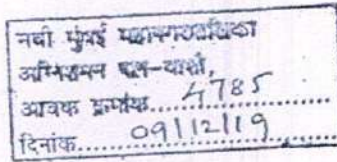

Srivatsa Sai Krishna .

Orchids The International School

Principal

Principa. Torane



LATE SMT. HANJABAI GAHLOT CHARITABLE TRUST

Gahlot Complex, Plot No 28 A, Sector 10, Opp Sarsola Bus Depot (Phase - II) Nerul, Navi Mumbai - 400 706